


Waste flows for common construction and demolition waste

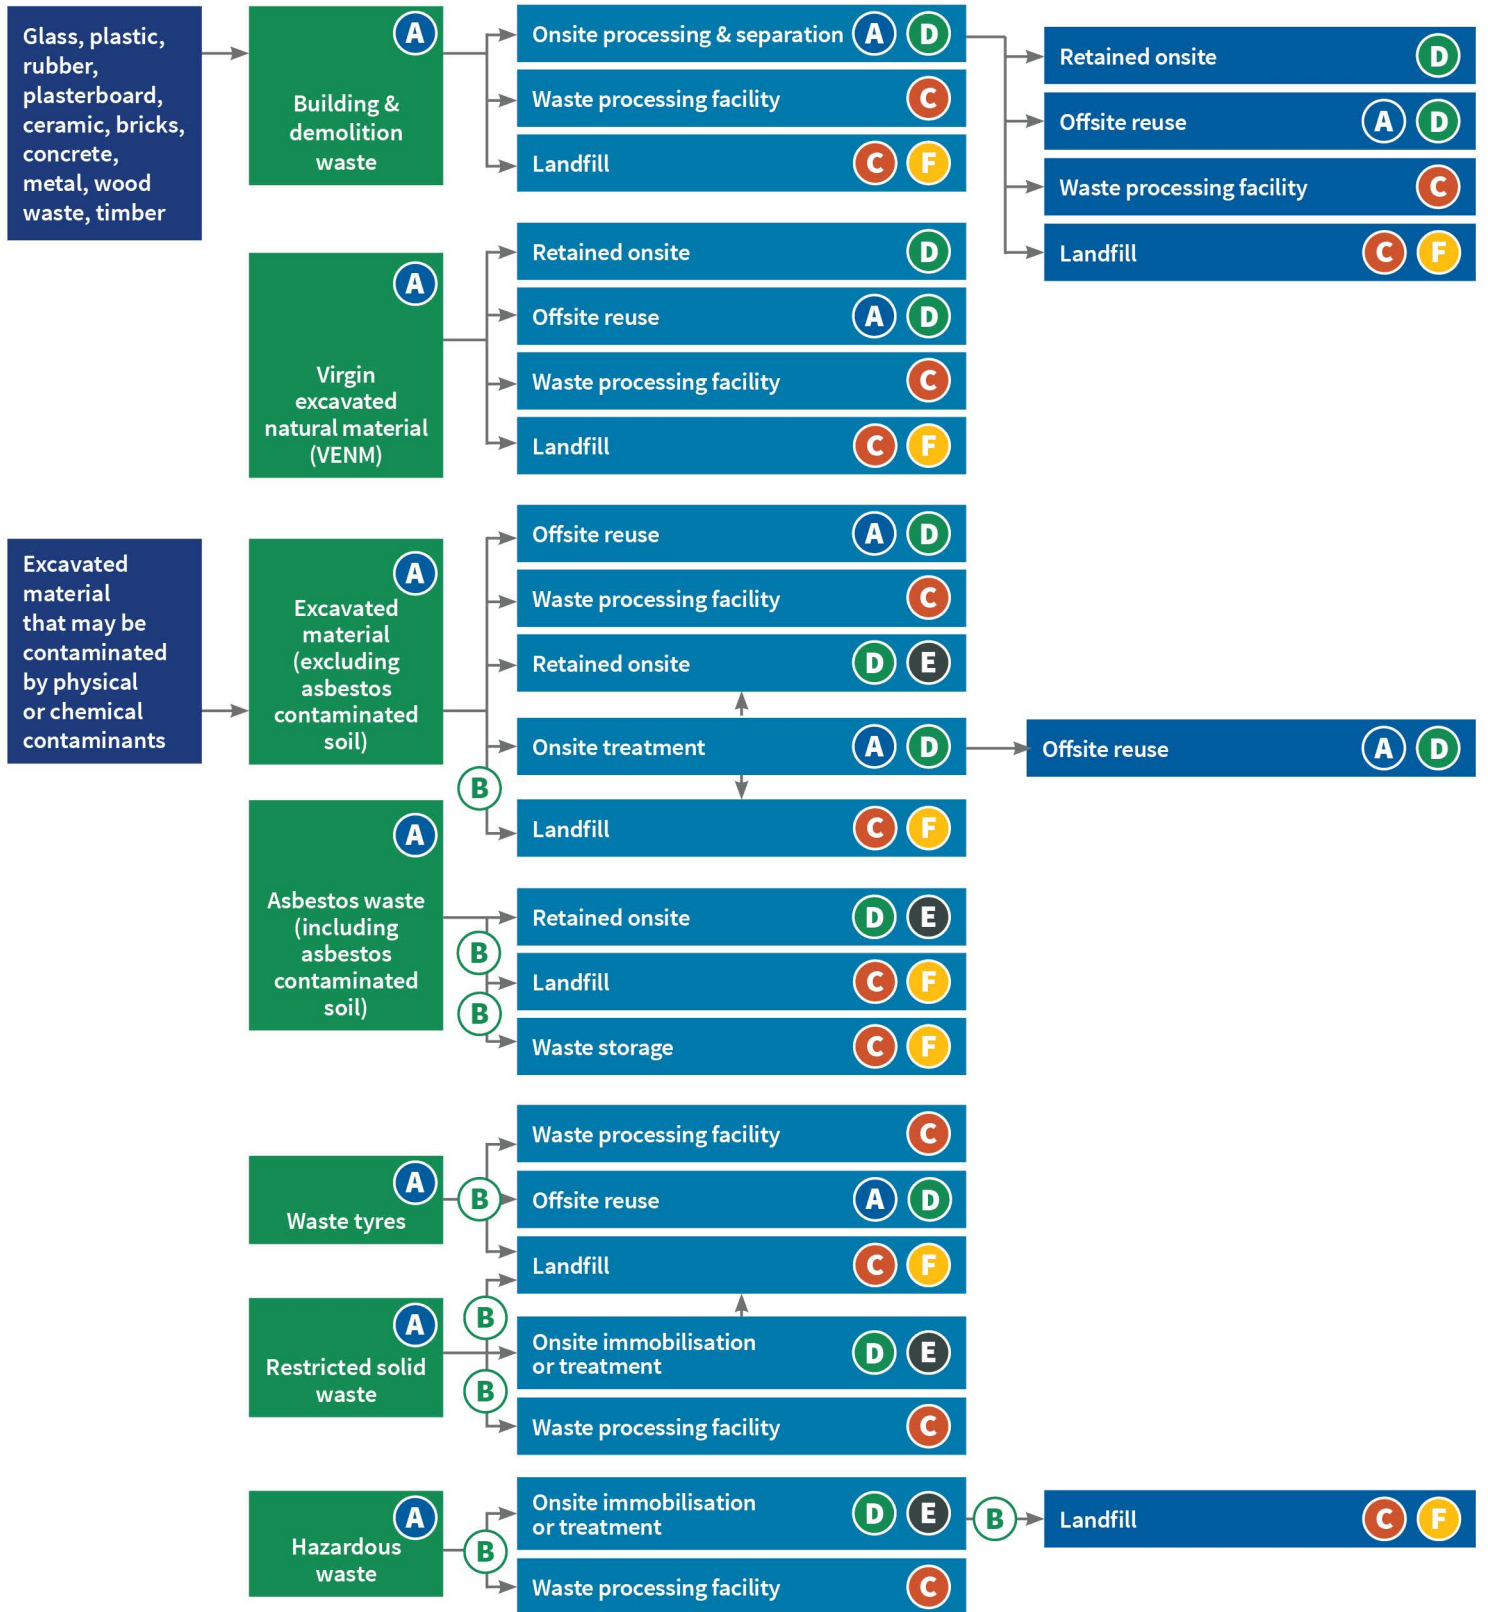

Key

- (A) Testing requirements**
 - Classified in accordance with the Waste Classification Guidelines
 - If applicable:
 - Compliance with relevant Resource Recovery Order for the waste
 - Compliance with relevant Resource Recovery Exemption for the waste
- (B) Transport requirements may apply:**
 - WasteLocate (asbestos waste and waste tyres)
 - Waste tracking required for wastes listed in schedule 1 of the POEO Waste Regulation
- (C) Receive facility must have planning approval and may require an EPL for that waste type**
- (D) Required development consent**
- (E) SEPP 55 - land use suitability criteria and CLM Act applies**
- (F) Waste levy applies**

Note: Waste tracking also required for wastes generated in the MLA and transported interstate.